


PLAN VIEW: GENERAL PIPE LAYOUT

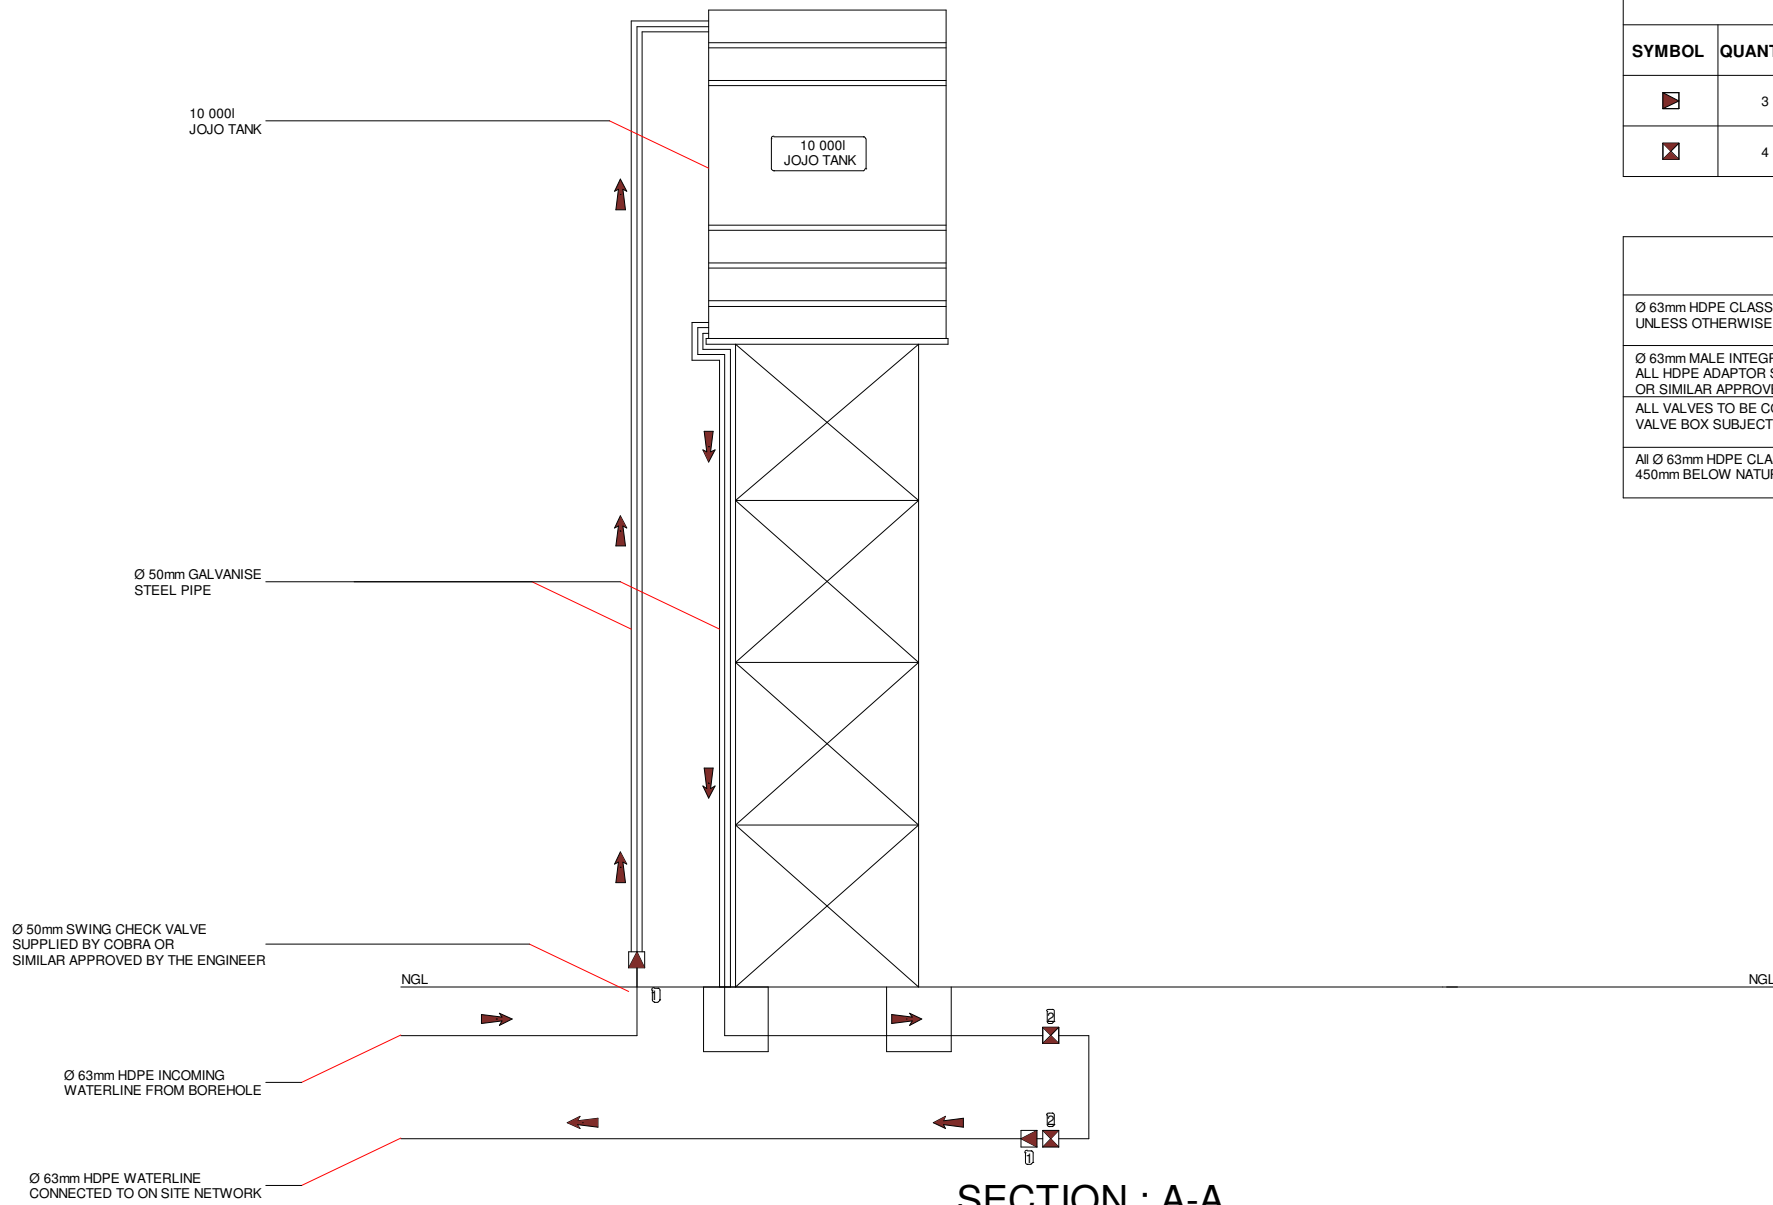

SECTION : A-A

NOTES		
SYMBOL	QUANTITY	DESCRIPTION
	3	Ø 50mm SWING CHECK VALVE SUPPLIED BY COBRA OR SIMILAR APPROVED BY THE ENGINEER
	4	Ø 50mm ISOLATING BALL VALVE SUPPLIED BY COBRA OR SIMILAR APPROVED BY THE ENGINEER

NOTES	
Ø 63mm HDPE CLASS 9 PIPE TO BE USED FOR ALL INTERNAL WATER LINES UNLESS OTHERWISE INDICATED	
Ø 63mm MALE INTEGRAL BRASS THREAD TO BE USED FOR ALL HDPE ADAPTOR SUPPLIED BY PASSON OR SIMILAR APPROVED BY THE ENGINEER	
ALL VALVES TO BE COVERED WITH A VALVE BOX. VALVE BOX SUBJECT TO APPROVAL BY THE ENGINEER	
All Ø 63mm HDPE CLASS 9 PIPE TO BE PLACED AT A MINIMUM OF 450mm BELOW NATURAL GROUND LEVEL	

REVISION		
NO.	DATE	DESCRIPTION

NOTES

 **BLOBERG MUNICIPALITY**
 PO Box 1593, Senwabarwana
 Tel: 015 505 7100
 Fax: 015 505 0296
 Email: MotsokoM@bloberg.gov.za

 **DIKGABO CONSULTING ENGINEERS**
 ENGINEER
 PO Box 1365, Gallo Manor, 2052
 Tel: 011 656 4075
 Fax: 086 555 7497
 Email: floyd@dikgabo.co.za

DESIGN	F RAKAU
REG. NO.	20070023
SIGNATURE	
DATE	
DRAWN BY	M MNGADI
ENGINEER	F M RAKAU
REG. NO.	20070023
SIGNATURE	
DATE	
CLIENT	
SIGNATURE	DATE

PROJECT
TOWERFONTEIN CRÉCHE

DRAWING TITLE
WATER TANK STAND DETAILS

DATE	OCTOBER 2019
SCALE	AS SHOWN
PROJECT NO.	BM07/18/19
SHEET NO.	BM07/18/19 - 009
PRINT ISSUED	-

File Path